HPS Test Run, Cooling Plant Layout

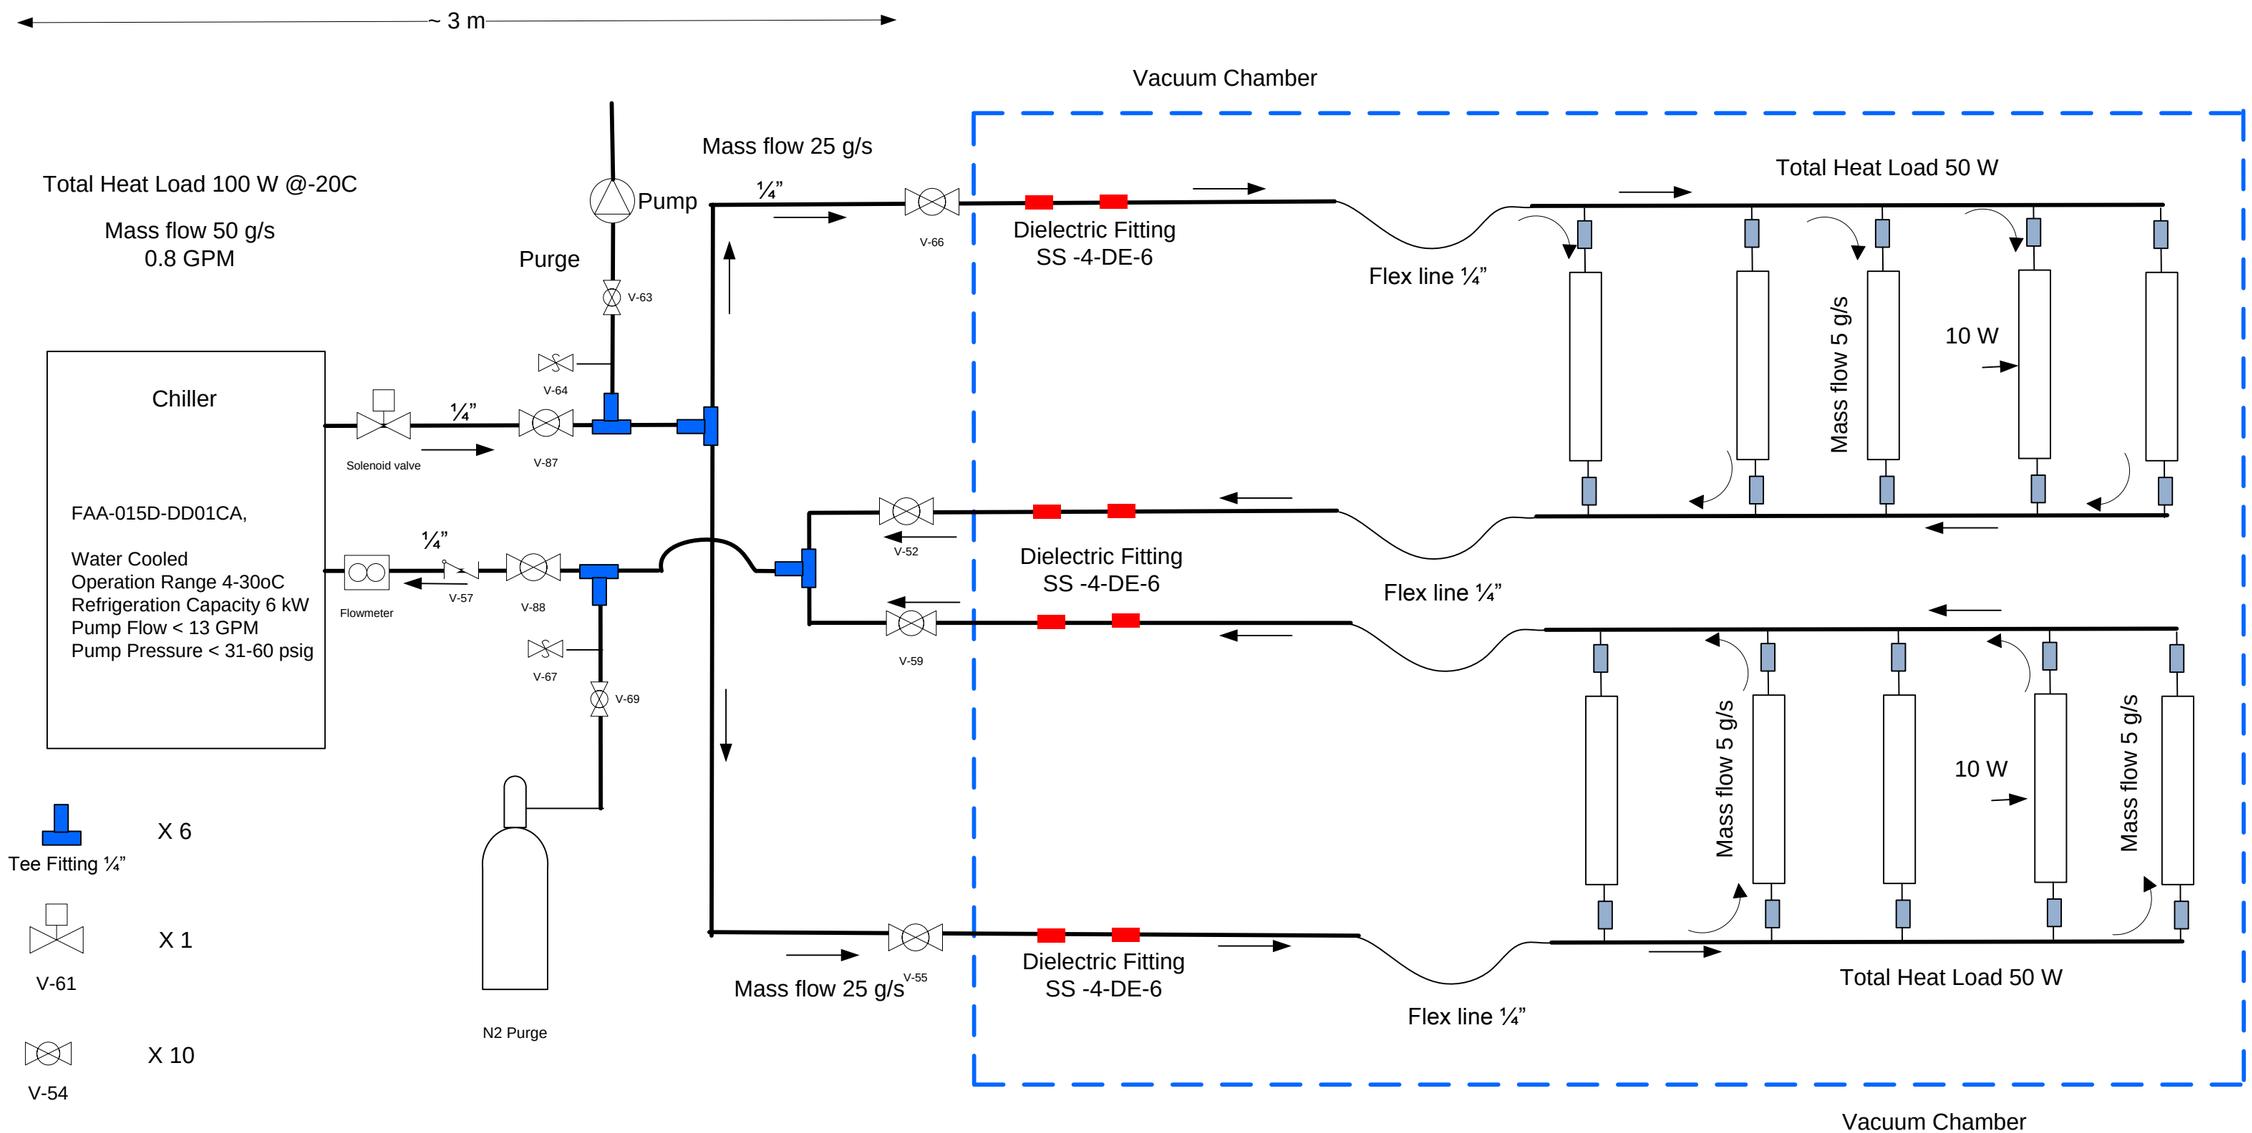

- Operation at Set Point
- Shut down single branch
- Purge Single Branch in vacuum
- Purge Branch out vacuum

Rev. Mar.5, 2012
M.Oriunno, SLAC